


ALTERNATE: 2'-0" WIDE JOINT UTILITY TRENCH, TRENCH DEPTH AND CONDUIT LOCATION PER TRENCH DETAIL. PROVIDE (2) 2" TELECOM CONDUIT AND (2) 5" ELECTRICAL CONDUIT. REPLACE PAVEMENT AND AGGREGATE SECTION TO MATCH EXISTING

OFFSITE ELECTRICAL FEED  
1"=60'-0"




TYPICAL CONDUIT SECTION  
JOINT WITH CATV & TELE  
SEE UGS CD 120

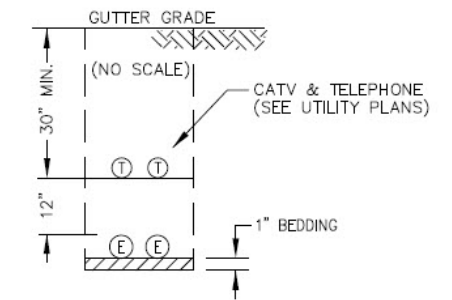

D81-J REV. 09/23/09

TRENCH DETAIL  
N.T.S

D81-J



Roesling Nakamura Terada  
Architects

285 N. Ventura Ave.#102  
Ventura, California  
P805.626.5330  
F805.626.5350  
www.RNTarchitects.com

TITLE: **OFFSITE ELECTRICAL FEED**

SCALE: 1" = 60'-0"

PROJ. NO: 895.01

REFERENCE SHEET NO:

DATE: 3/29/201

**PROBATION HEADQUARTERS**

SHEET NO:

**EXHIBIT-1**

1019 GARDEN STREET  
SANTA BARBARA, CA 93101